


DETAIL 03410-9 COBB COUNTY WATER SYSTEM MANHOLE RAISING IN PAVEMENT

MAY 1, 2001

AGENCY DIRECTOR

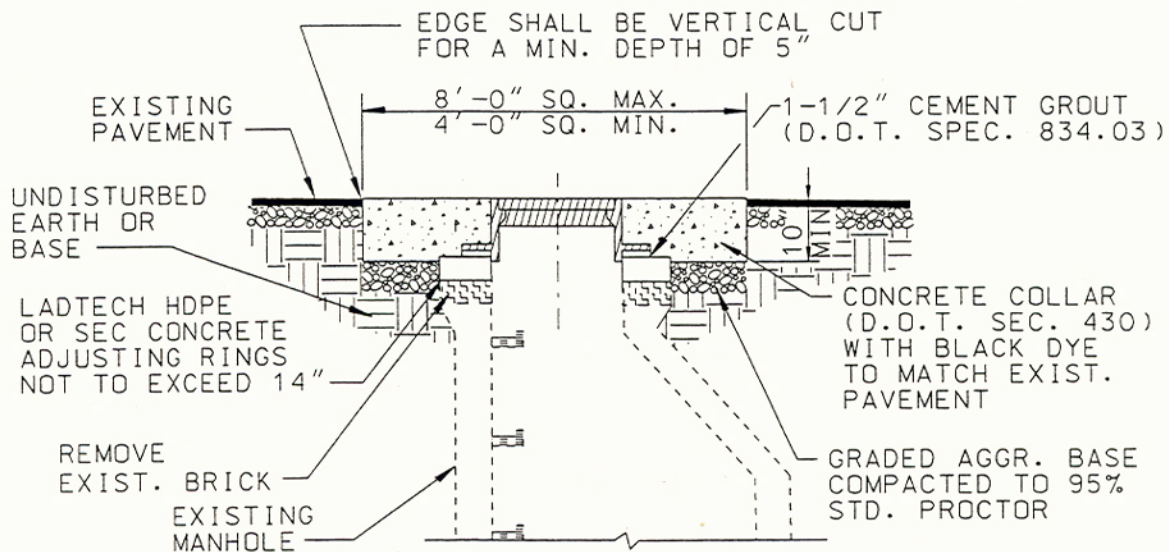

MANHOLE RAISING NOTES :

1. CONCRETE FOR COLLAR SHALL BE A MIN. OF 10" THICK.
2. IF REPLACEMENT OF THE FRAME & COVER IS NECESSARY, ACCEPTABLE PRODUCTS ARE EAST JORDAN IRON WORKS V-1480-1 OR U.S. FOUNDRY 360E.
3. ALL MANHOLE FRAME GRADE ADJUSTMENTS SHALL CONFORM TO THE REQUIREMENTS OF THIS DETAIL.